

FIG.1

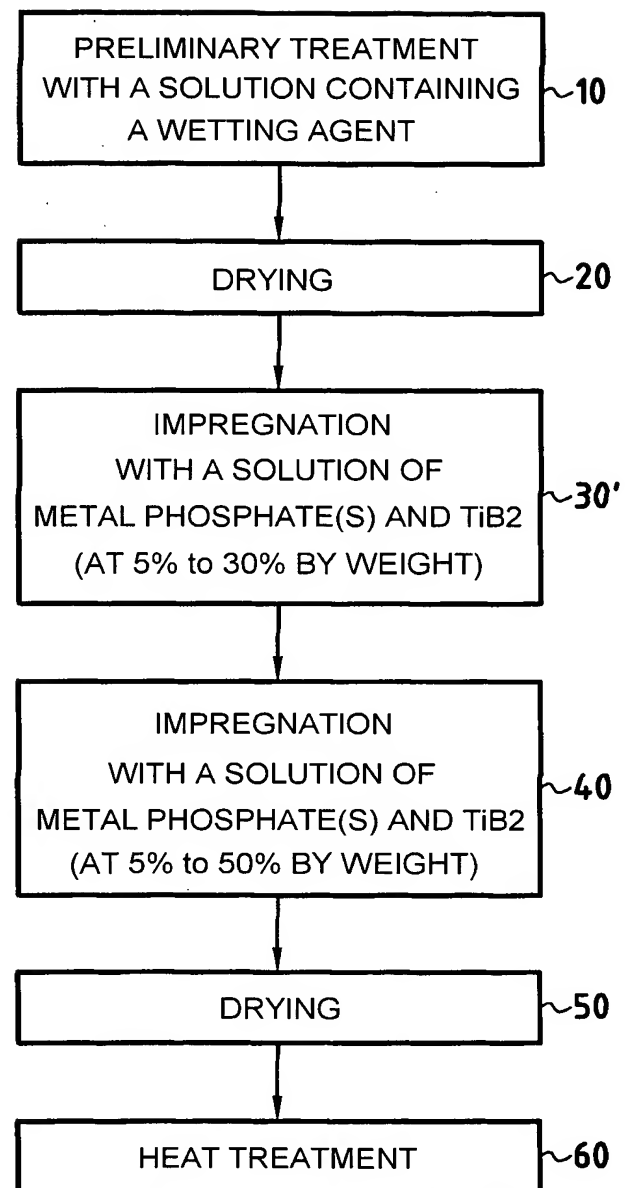


FIG.2

2/6

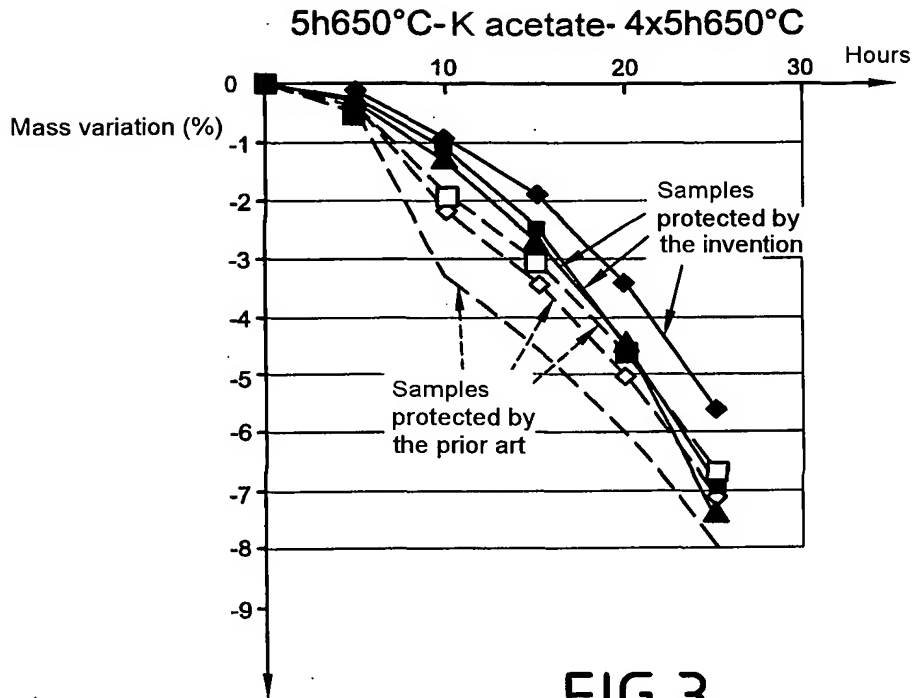


FIG.3

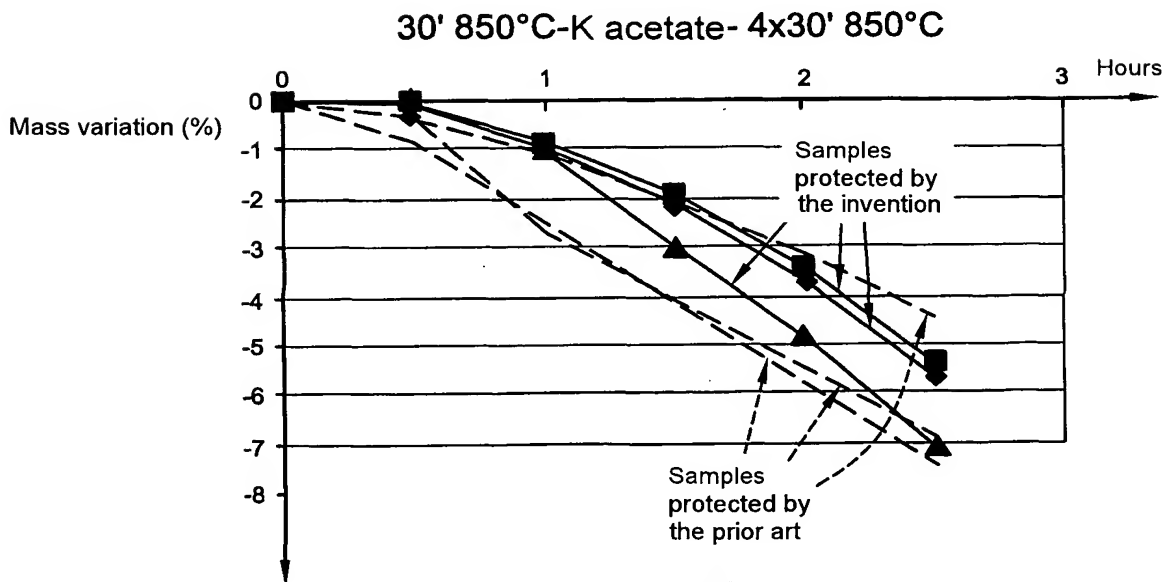


FIG.4

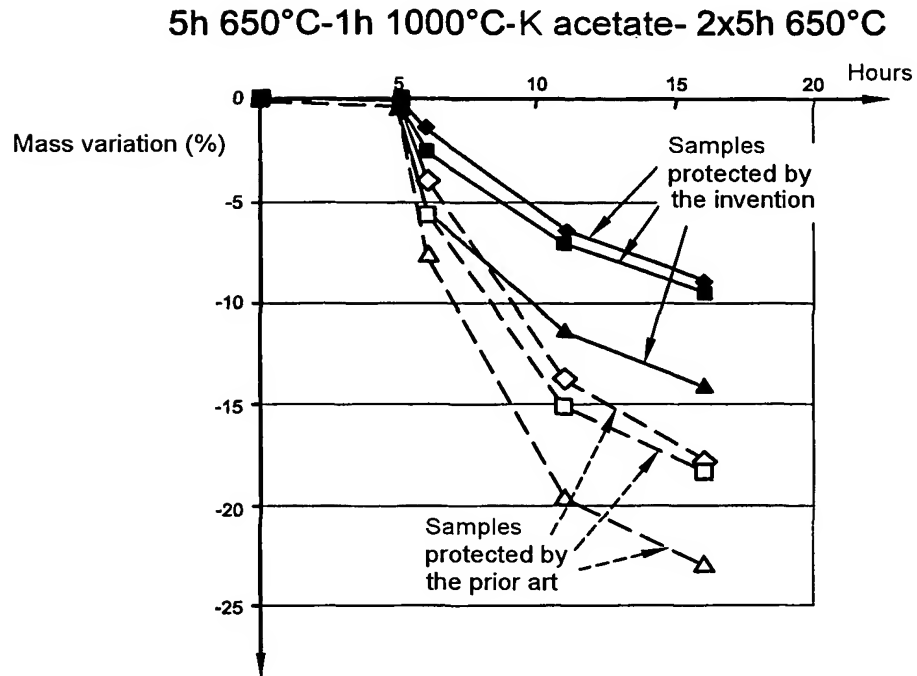


FIG. 5

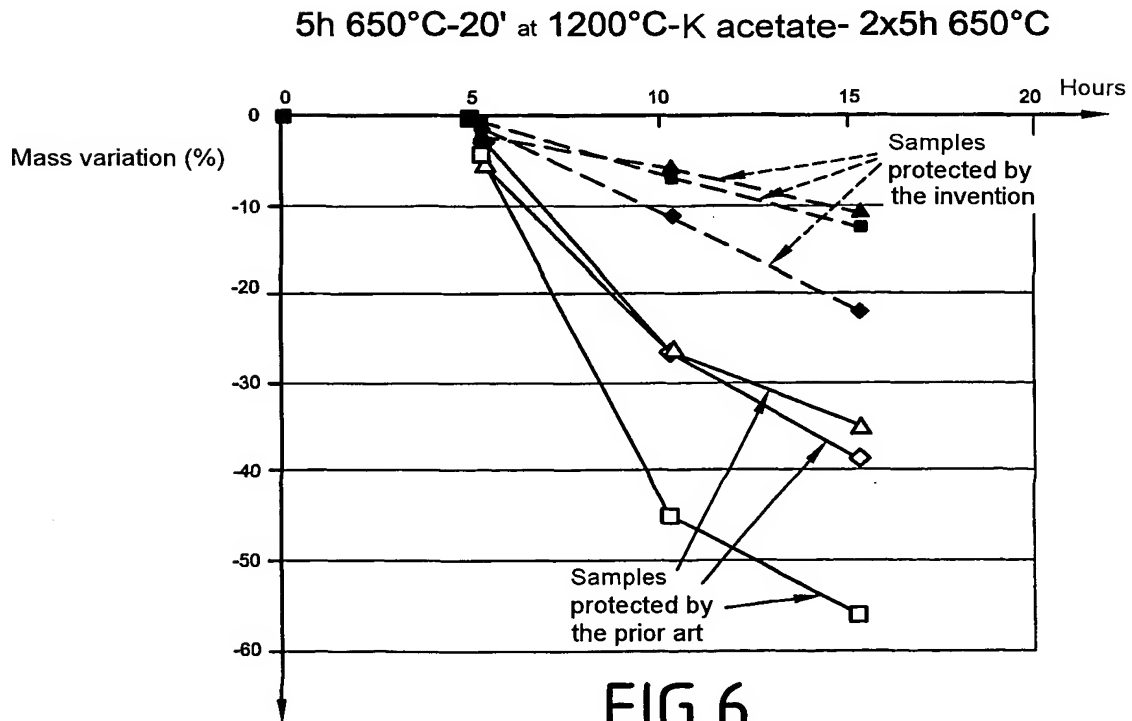


FIG. 6

4/6

5h 650°C-20' at 1200°C- 2x5h 650°C

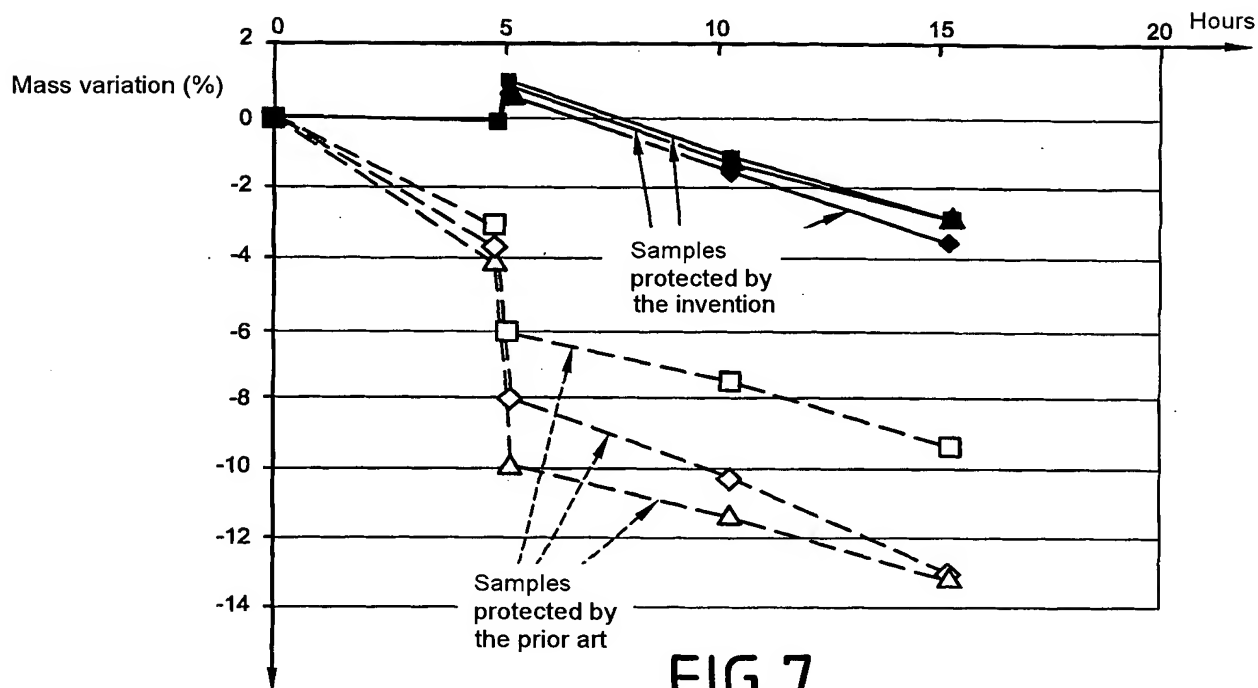


FIG.7

5h 650°C-10' at 1400°C- 2x5h 650°C

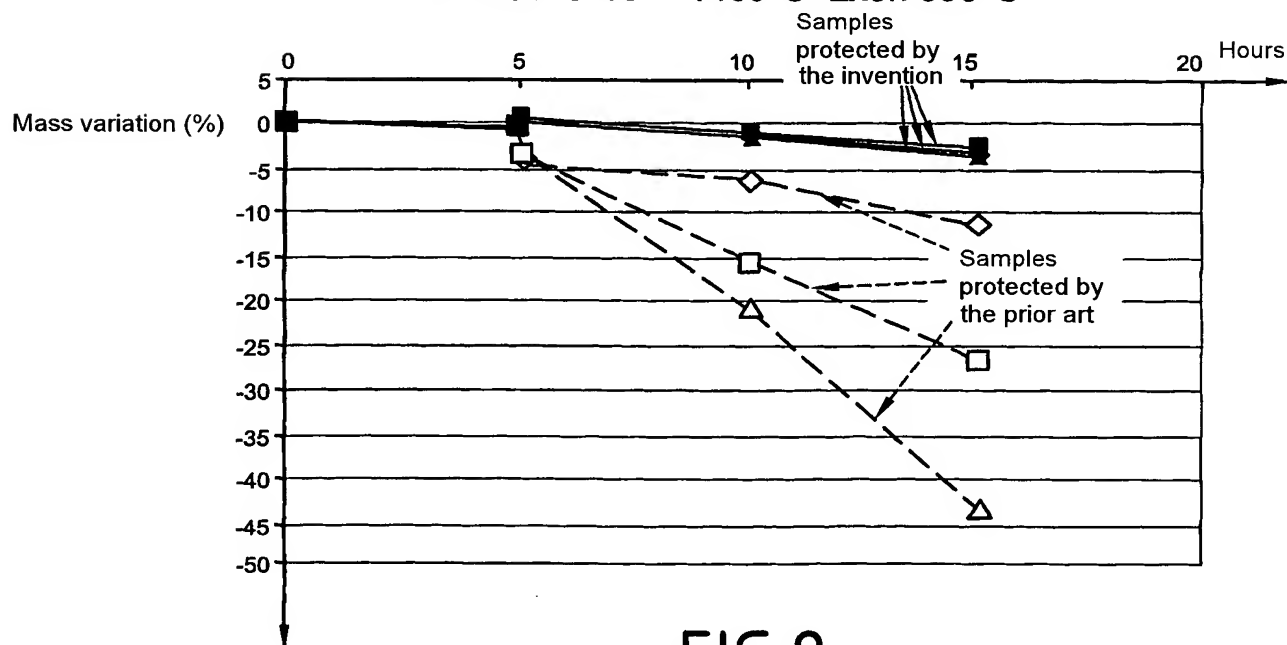


FIG.8

5h 650°C-20' at 1200°C- 24h tap water - 2x5h 650°C

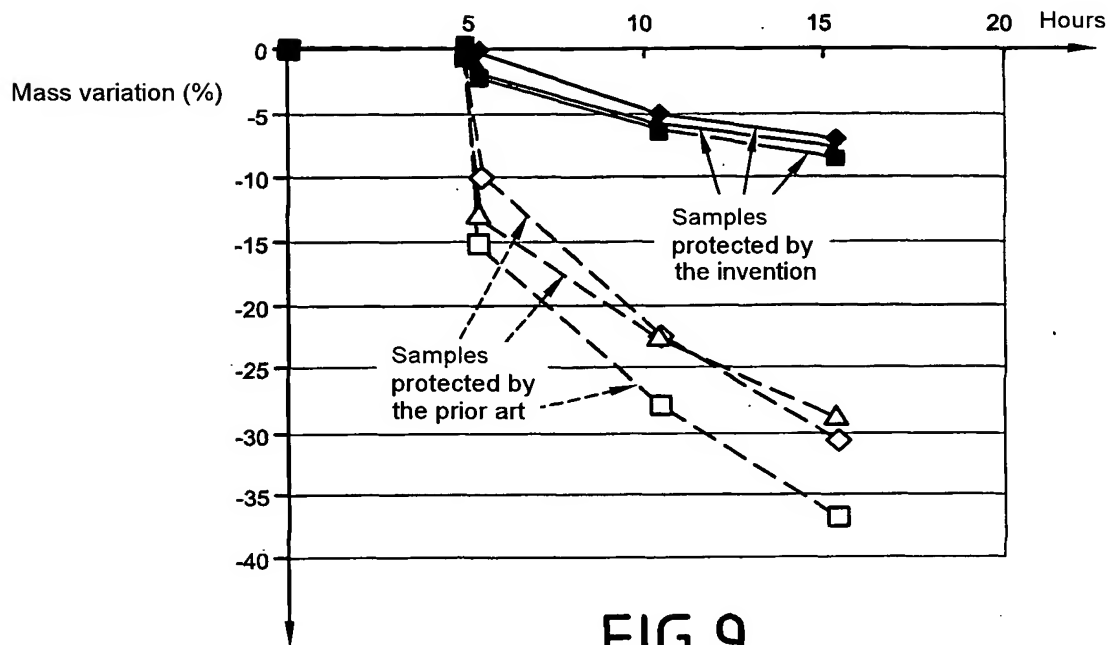


FIG. 9

5h 650°C-20' at 1200°C- 1h boiling water - 2x5h 650°C

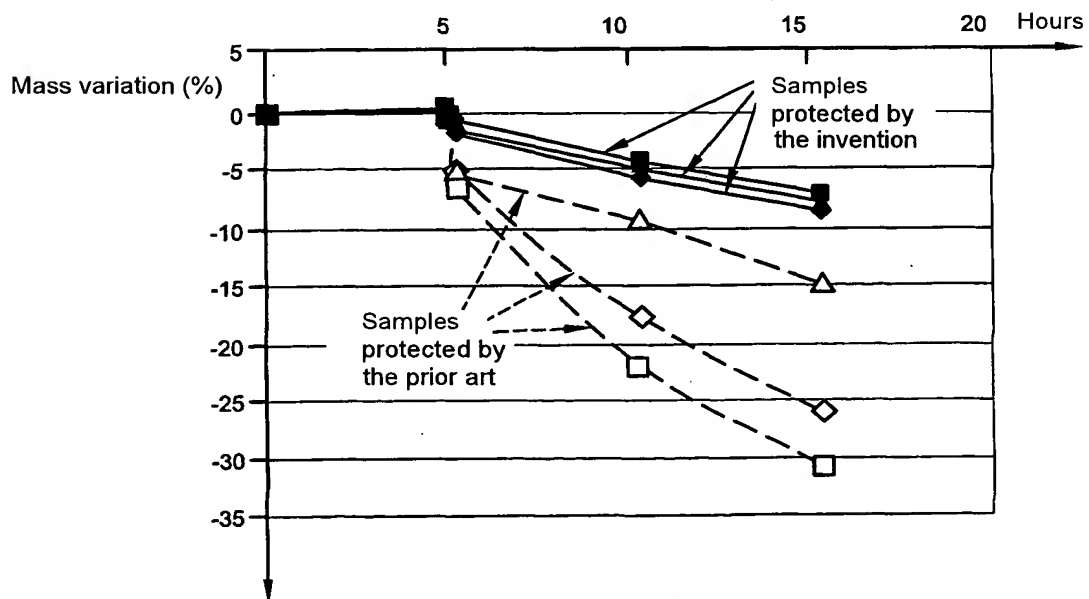


FIG. 10

6/6

5h 650°C-20' at 1200°C- K acetate- 2x5h 650°C

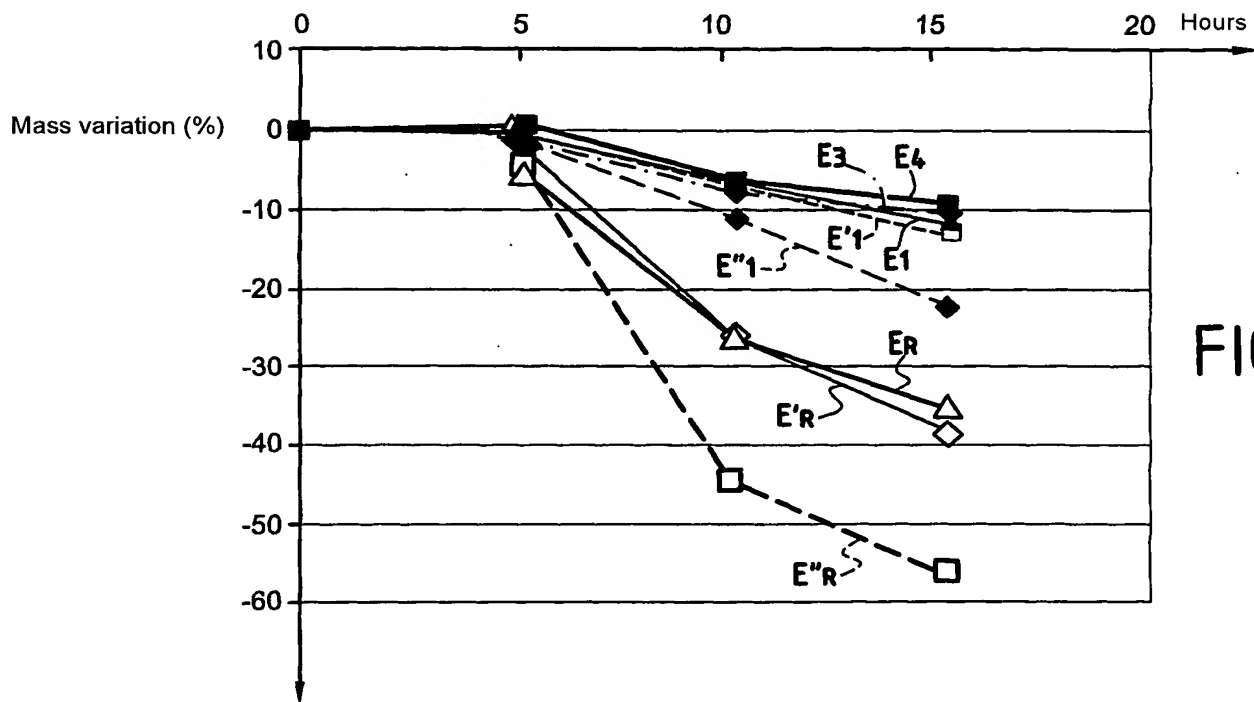


FIG. 11

5h 650°C-20' at 1200°C-2x5h 650°C

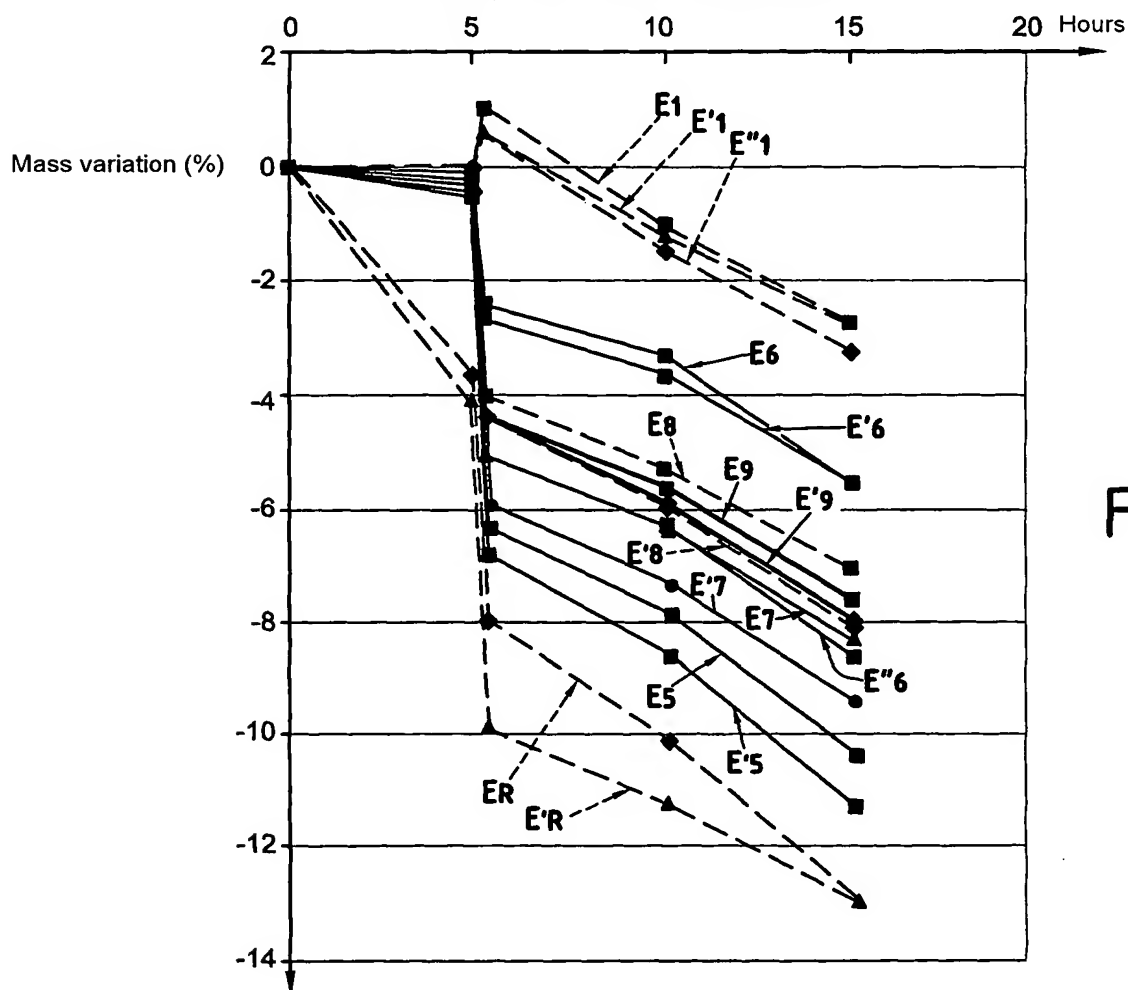


FIG. 12